



Circuit-breaker, 3p, 80A

| | |
|-----------------------|------------|
| Part no. | NZMB1-M80 |
| Catalog No. | 265713 |
| EL-Nummer (Norway) | 0004315562 |

Similar to illustration


Delivery program

| | | | |
|--|---|----|---------|
| Product range | Circuit-breaker | | |
| Protective function | Motor protection | | |
| | IE3 ✓ | | |
| Standard/Approval | IEC | | |
| Installation type | Fixed | | |
| Release system | Thermomagnetic release | | |
| Construction size | NZM1 | | |
| Description | With phase-failure sensitivity Tripping class 10 A IEC/EN 60947-4-1, IEC/EN 60947-2 The circuit-breaker fulfills all requirements for AC-3 switching category. | | |
| Number of poles | 3 pole | | |
| Standard equipment | Box terminal | | |
| Switching capacity | | | |
| 400/415 V 50 Hz | I_{cu} | kA | 25 |
| Rated current = rated uninterrupted current | $I_n = I_u$ | A | 80 |
| Setting range | | | |
| Overload trip | I_r | A | 63 - 80 |
| | | | |
| Short-circuit releases | $I_i = I_n \times \dots$ | | |
| | | | |
| Non-delayed | $I_i = I_n \times \dots$ | | 8 - 14 |
| | | | |
| Motor rating AC-3 50/60 Hz | | | |
| 380 V 400 V | P | kW | 37 |
| Motor rating AC-3 50/60 Hz | | | |
| 400 V | P | kW | 37 |
| Rated operational current AC-3 50/60 Hz | | | |
| 400 V | I_e | A | 68 |

Technical data

General

| | | | |
|-----------------------------------|--|--------------|--|
| Standards | IEC/EN 60947 | | |
| Protection against direct contact | Finger and back of hand proof to VDE 0106 Part 100 | | |
| Climatic proofing | Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30 | | |
| Ambient temperature | | | |
| Ambient temperature, storage | $^{\circ}C$ | - -40 - + 70 | |
| Operation | $^{\circ}C$ | -25 - +70 | |

| | | |
|---|-------------|---|
| Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27 | g | 20 (half-sinusoidal shock 20 ms) |
| Safe isolation to EN 61140 | | |
| Between auxiliary contacts and main contacts | V AC | 500 |
| between the auxiliary contacts | V AC | 300 |
| Mounting position | | <p>Vertical and 90° in all directions</p>  <p>With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions</p> |
| Direction of incoming supply | | as required |
| Degree of protection | | |
| Device | | In the operating controls area: IP20 (basic degree of protection) |
| Enclosures | | With insulating surround: IP40 With door coupling rotary handle: IP66 |
| Terminations | | Tunnel terminal: IP10 Phase isolator and strip terminal: IP00 |
| Other technical data (sheet catalogue) | | Temperature dependency, Derating |
| Circuit-breakers | | |
| Rated current = rated uninterrupted current | $I_n = I_u$ | A 80 |
| Rated surge voltage invariability | U_{imp} | |
| Main contacts | | V 6000 |
| Auxiliary contacts | | V 6000 |
| Rated operational voltage | U_e | V AC 440 |
| Oversupply category/pollution degree | | III/3 |
| Rated insulation voltage | U_i | V 690 |
| Use in unearthing supply systems | | V ≤ 440 |
| Switching capacity | | |
| Rated short-circuit making capacity | I_{cm} | |
| 240 V | I_{cm} | kA 63 |
| 400/415 V | I_{cm} | kA 53 |
| 440 V 50/60 Hz | I_{cm} | kA 53 |
| Rated short-circuit breaking capacity I_{cn} | I_{cn} | |
| Icu to IEC/EN 60947 test cycle 0-t-CO | Icu | kA |
| 240 V 50/60 Hz | I_{cu} | kA 30 |
| 400/415 V 50/60 Hz | I_{cu} | kA 25 |
| 440 V 50/60 Hz | I_{cu} | kA 25 |
| Ics to IEC/EN 60947 test cycle 0-t-CO-t-CO | Ics | kA |
| 240 V 50/60 Hz | I_{cs} | kA 30 |
| 400/415 V 50/60 Hz | I_{cs} | kA 25 |
| 440 V 50/60 Hz | I_{cs} | kA 18.5 |
| | | Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker. |
| Utilization category to IEC/EN 60947-2 | | A |
| Lifespan, mechanical (of which max. 50 % trip by shunt/undervoltage release) | Operations | 20000 |
| Lifespan, electrical | | |
| AC-1 | | |
| 400 V 50/60 Hz | Operations | 7500 |
| 415 V 50/60 Hz | Operations | 7500 |
| Max. operating frequency | Ops/h | 120 |
| Total downtime in a short-circuit | ms | < 10 |

Terminal capacity

| | | | |
|---|-----------------|--|-------------|
| Standard equipment | | Box terminal | |
| Optional accessories | | Screw connection Tunnel terminal connection on rear | |
| Round copper conductor | | | |
| Box terminal | | | |
| Solid | mm ² | 1 x (10 - 16) 2 x (6 - 16) | |
| Stranded | mm ² | 1 x (10 - 70) ³⁾ 2 x (6-25) | |
| | | ³⁾ Up to 95 mm ² can be connected depending on the cable manufacturer. | |
| Tunnel terminal | | | |
| Solid | mm ² | 1 x 16 | |
| Stranded | mm ² | | |
| 1-hole | mm ² | 1 x (25 - 95) | |
| Bolt terminal and rear-side connection | | | |
| Direct on the switch | | | |
| Solid | mm ² | 1 x (10 - 16) 2 x (6 - 16) | |
| Stranded | mm ² | 1 x (10 - 70) ³⁾ 2 x 25 | |
| | | ³⁾ Up to 95 mm ² can be connected depending on the cable manufacturer. | |
| Al circular conductor | | | |
| Tunnel terminal | | | |
| Solid | mm ² | 1 x 16 | |
| Stranded | mm ² | | |
| Stranded | mm ² | 1 x (25 - 95) | |
| Bolt terminal and rear-side connection | | | |
| Direct on the switch | | | |
| Solid | mm ² | 1 x (10 - 16) 2 x (10 - 16) | |
| Stranded | mm ² | 1 x (25 - 35) 2 x (25 - 35) | |
| Cu strip (number of segments x width x segment thickness) | | | |
| Box terminal | | | |
| | min. | mm | 2 x 9 x 0.8 |
| | max. | mm | 9 x 9 x 0.8 |
| Copper busbar (width x thickness) | mm | | |
| Bolt terminal and rear-side connection | | | |
| Screw connection | | M6 | |
| Direct on the switch | | | |
| | min. | mm | 12 x 5 |
| | max. | mm | 16 x 5 |
| Control cables | | | |
| | mm ² | 1 x (0.75 - 2.5) 2 x (0.75 - 1.5) | |

Design verification as per IEC/EN 61439

| | | | |
|--|------------------|----|--|
| Technical data for design verification | | | |
| Rated operational current for specified heat dissipation | I _n | A | 80 |
| Equipment heat dissipation, current-dependent | P _{vid} | W | 20.83 |
| Operating ambient temperature min. | | °C | -25 |
| Operating ambient temperature max. | | °C | 70 |
| IEC/EN 61439 design verification | | | |
| 10.2 Strength of materials and parts | | | |
| 10.2.2 Corrosion resistance | | | Meets the product standard's requirements. |
| 10.2.3.1 Verification of thermal stability of enclosures | | | Meets the product standard's requirements. |

| | |
|--|--|
| 10.2.3.2 Verification of resistance of insulating materials to normal heat | Meets the product standard's requirements. |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects | Meets the product standard's requirements. |
| 10.2.4 Resistance to ultra-violet (UV) radiation | Meets the product standard's requirements. |
| 10.2.5 Lifting | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions | Meets the product standard's requirements. |
| 10.3 Degree of protection of ASSEMBLIES | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances | Meets the product standard's requirements. |
| 10.5 Protection against electric shock | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections | Is the panel builder's responsibility. |
| 10.8 Connections for external conductors | Is the panel builder's responsibility. |
| 10.9 Insulation properties | |
| 10.9.2 Power-frequency electric strength | Is the panel builder's responsibility. |
| 10.9.3 Impulse withstand voltage | Is the panel builder's responsibility. |
| 10.9.4 Testing of enclosures made of insulating material | Is the panel builder's responsibility. |
| 10.10 Temperature rise | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.12 Electromagnetic compatibility | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.13 Mechanical function | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |


Technical data ETIM 7.0


Low-voltage industrial components (EG000017) / Motor protection circuit-breaker (EC000074)

Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Motor protection circuit-breaker (ecl@ss10.0.1-27-37-04-01 [AGZ529016])


| | | |
|--|----|--|
| Overload release current setting | A | 63 - 80 |
| Adjustment range undelayed short-circuit release | A | 640 - 1120 |
| With thermal protection | | Yes |
| Phase failure sensitive | | Yes |
| Switch off technique | | Thermomagnetic |
| Rated operating voltage | V | 440 - 440 |
| Rated permanent current I_{p} | A | 80 |
| Rated operation power at AC-3, 230 V | kW | 22 |
| Rated operation power at AC-3, 400 V | kW | 45 |
| Type of electrical connection of main circuit | | Other |
| Type of control element | | Rocker lever |
| Device construction | | Built-in device fixed built-in technique |
| With integrated auxiliary switch | | No |
| With integrated under voltage release | | No |
| Number of poles | | 3 |
| Rated short-circuit breaking capacity I_{cu} at 400 V, AC | kA | 25 |
| Degree of protection (IP) | | IP20 |
| Height | mm | 145 |
| Width | mm | 90 |
| Depth | mm | 88 |

Characteristics

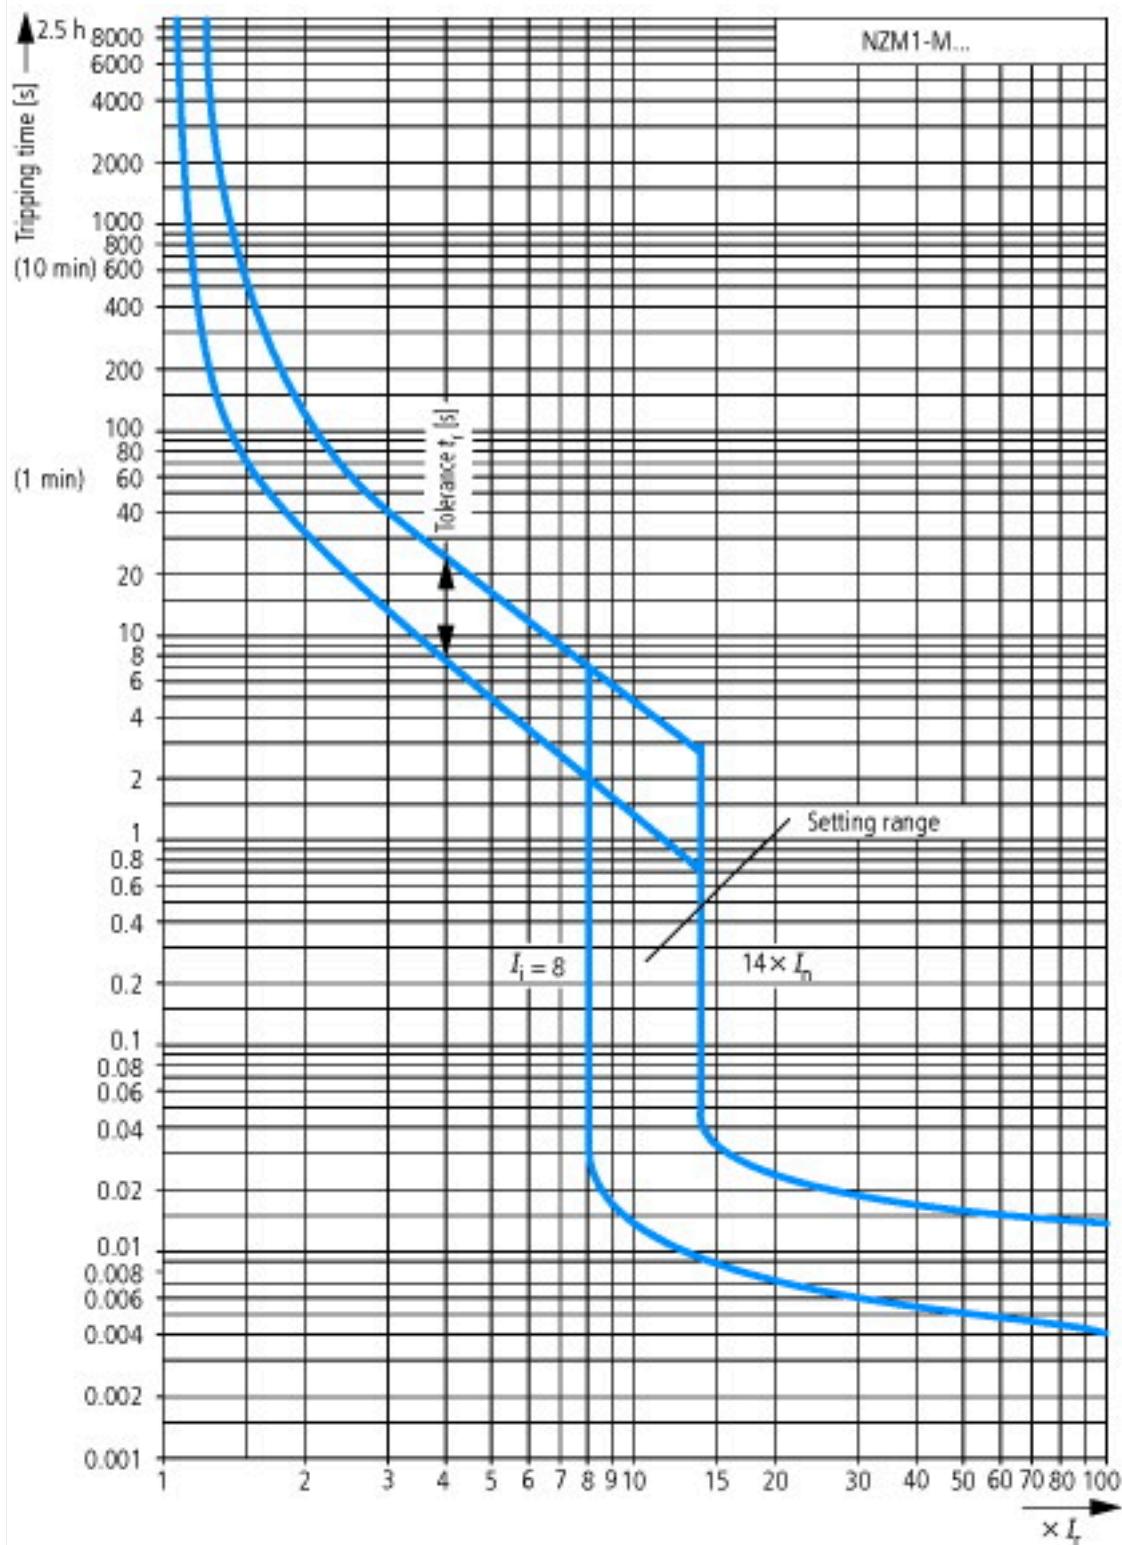

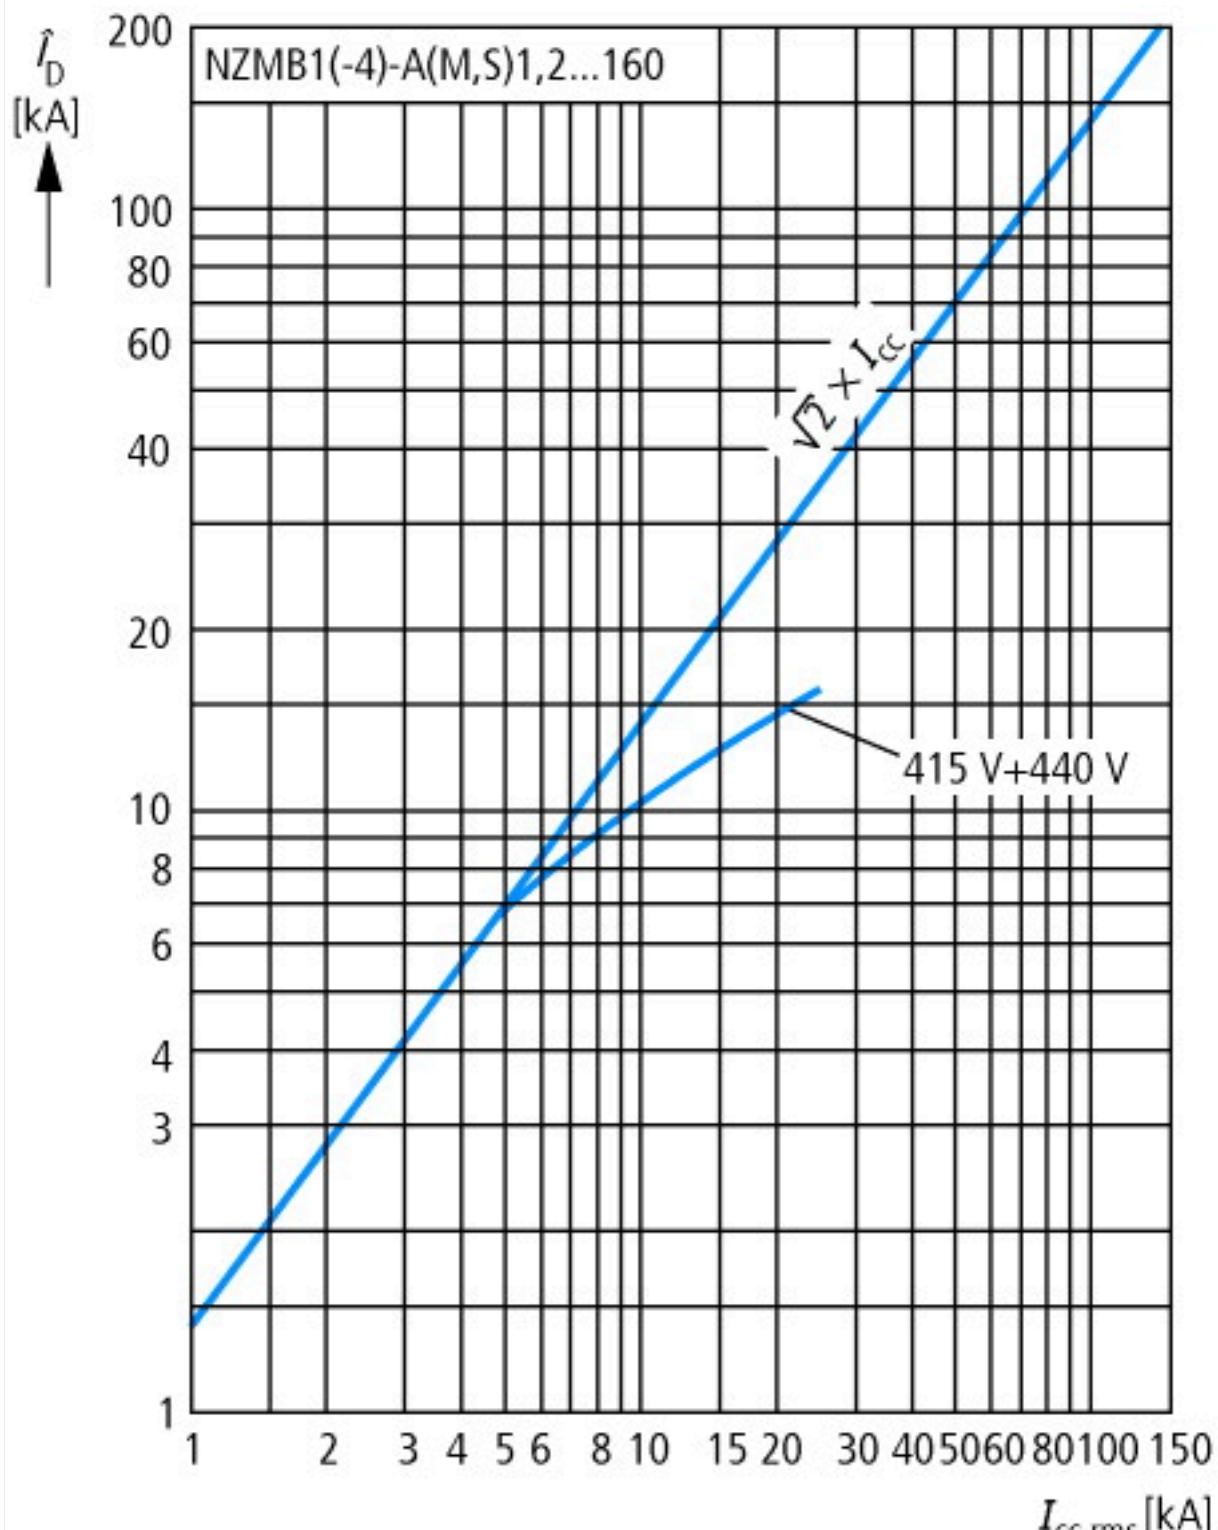



Let-through current

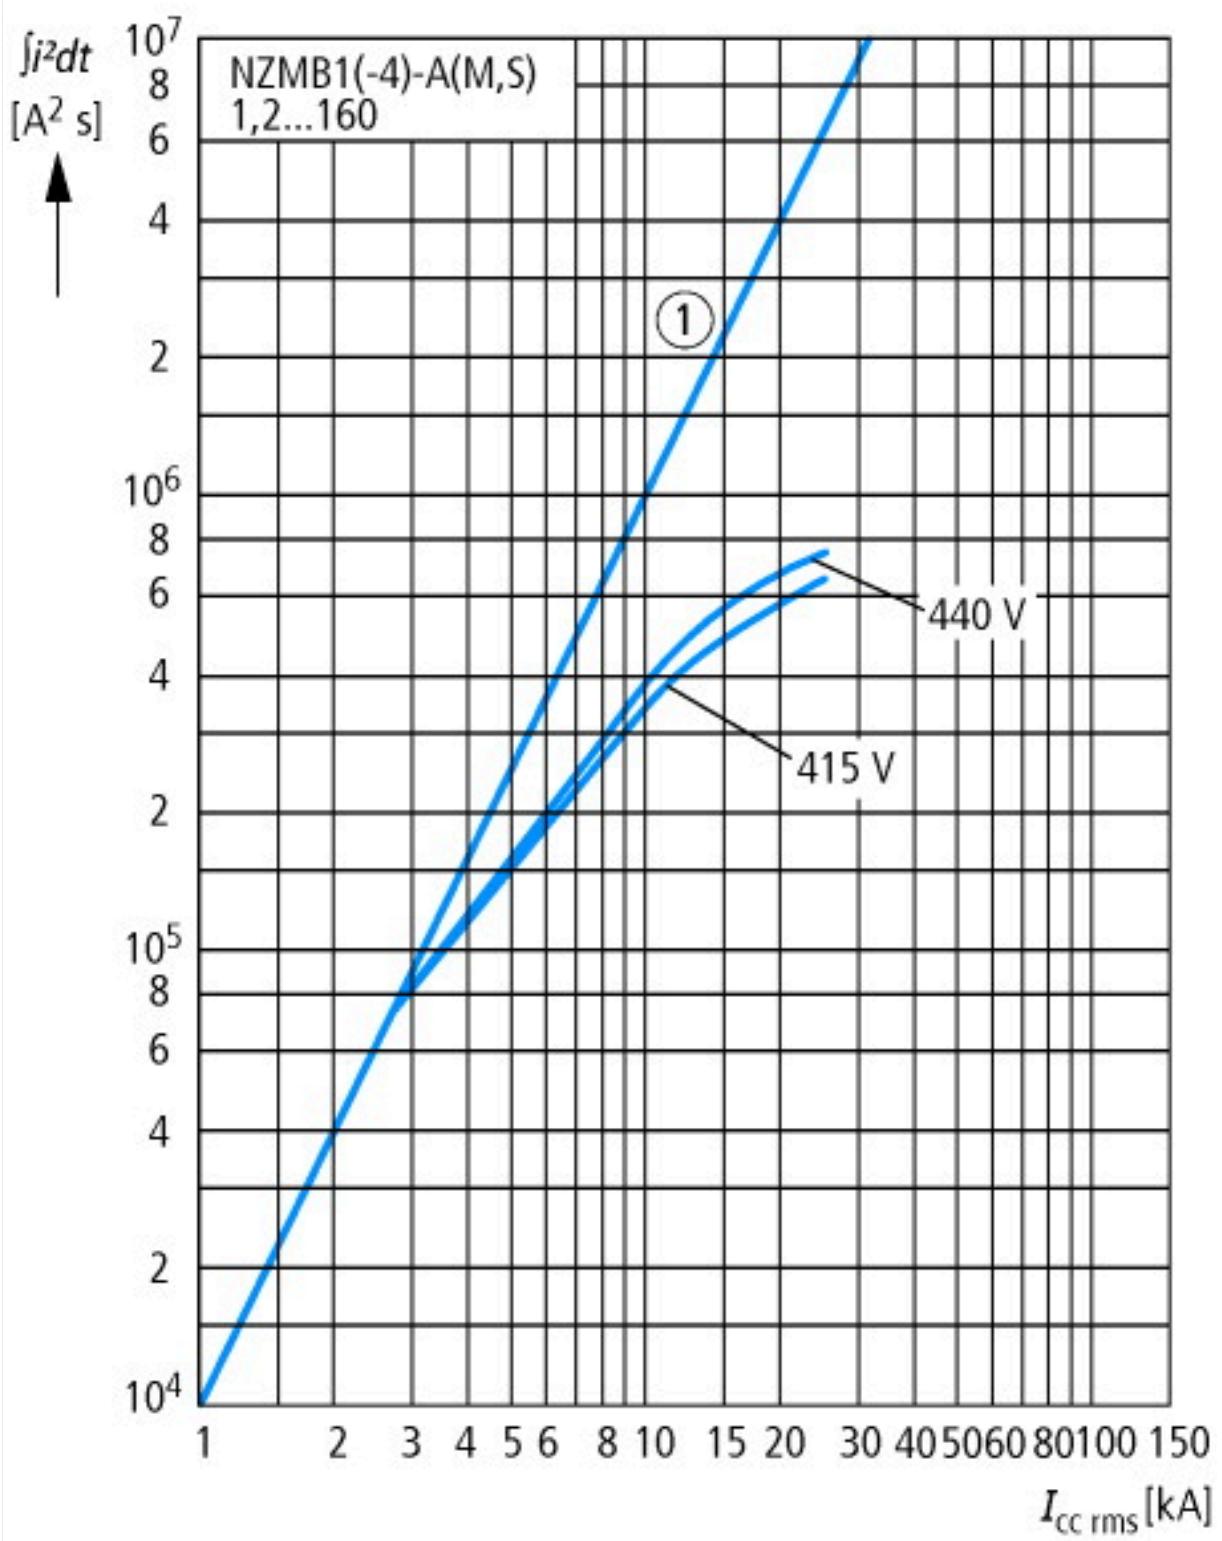

Let-through energy

Dimensions

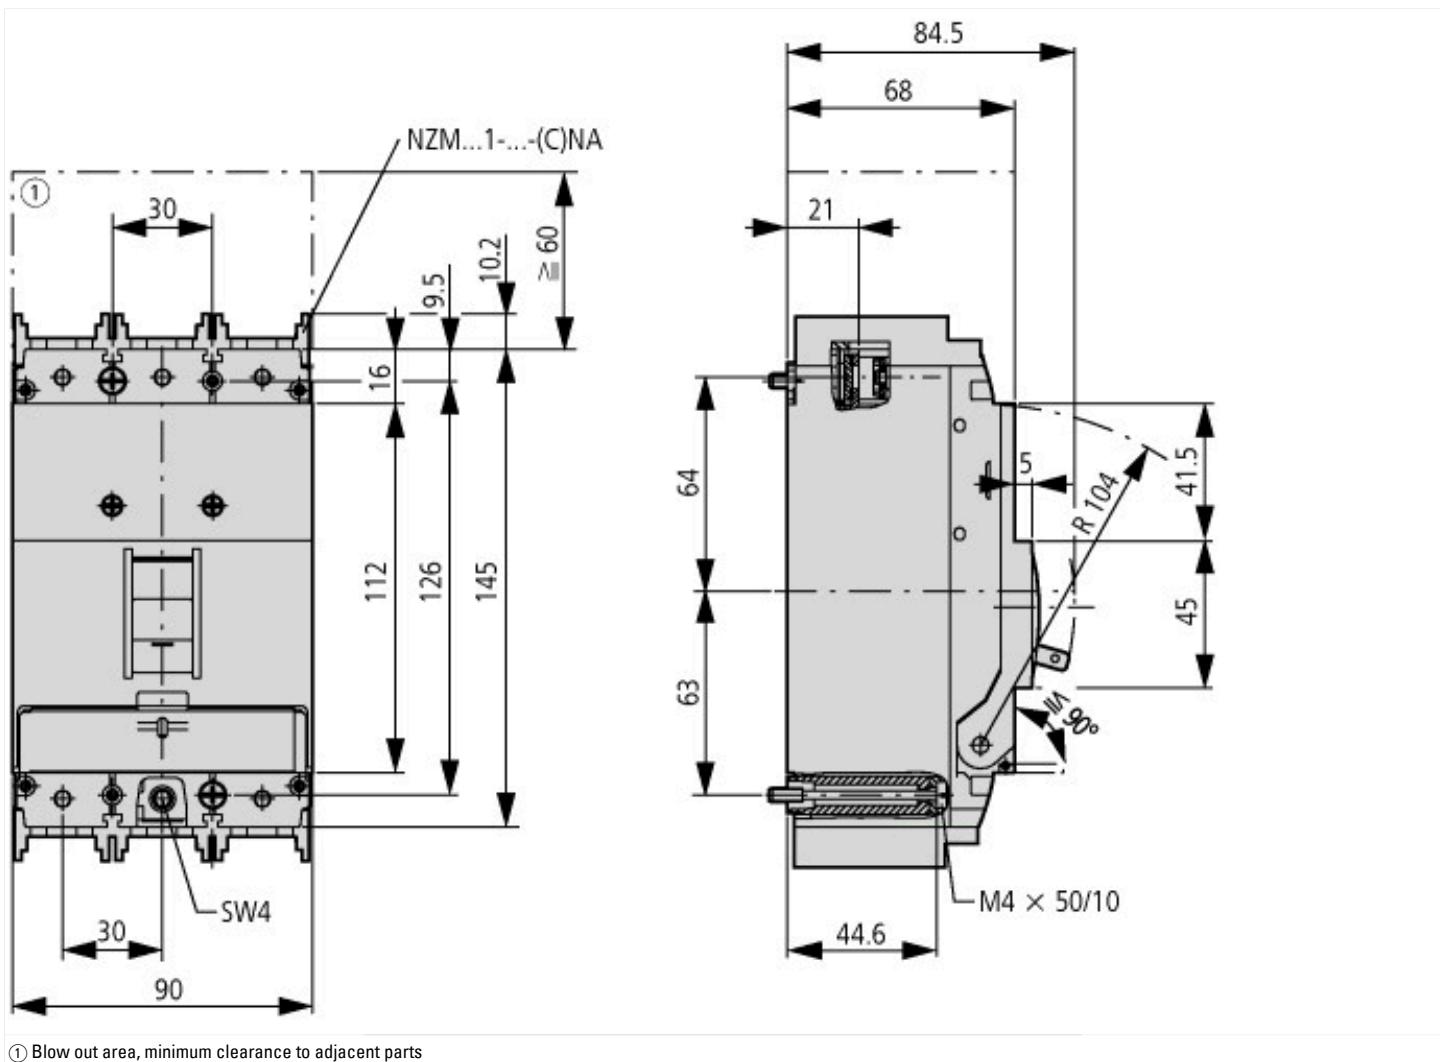

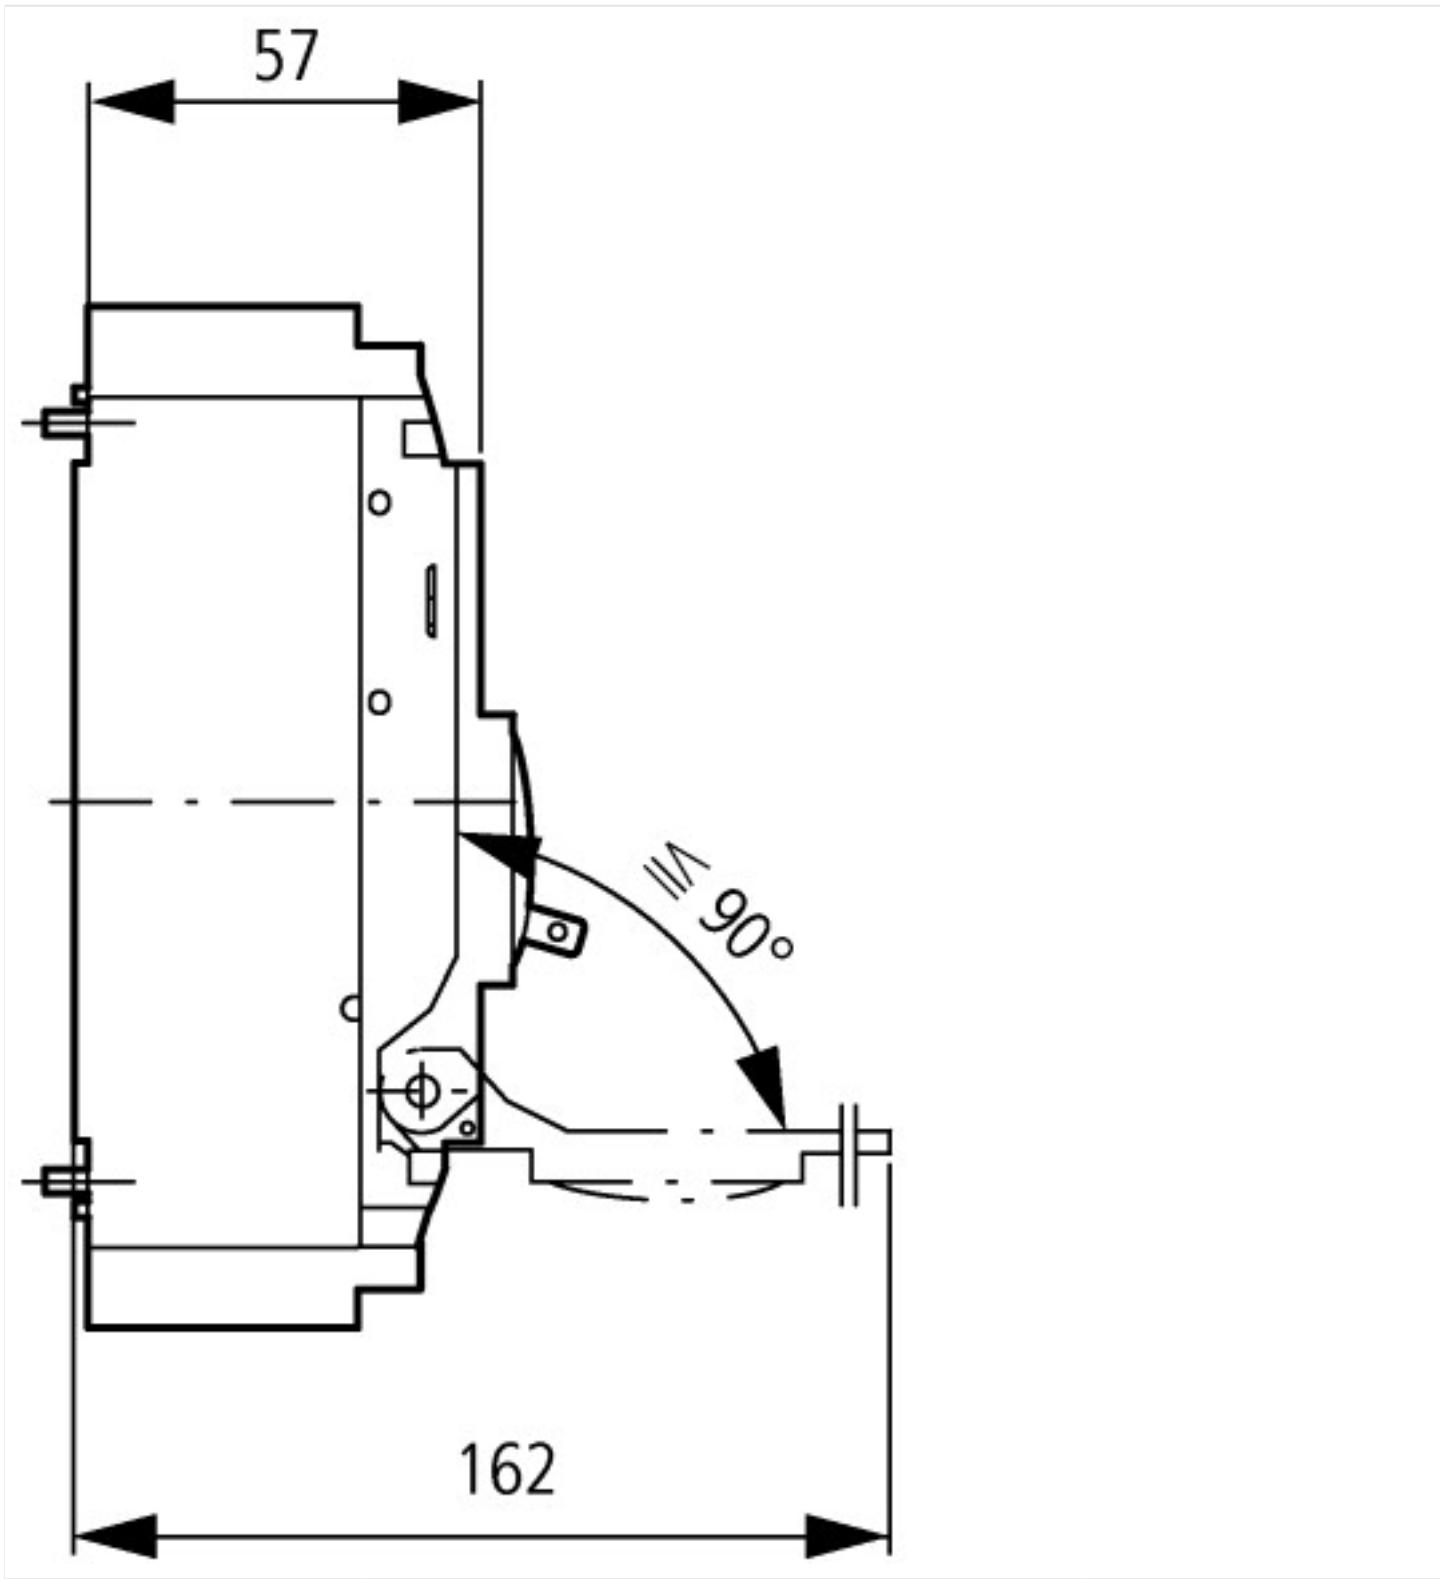

Additional product information (links)

IL01203004Z (AWA1230-1913) Circuit-breaker, Switch-Disconnector

IL01203004Z (AWA1230-1913) Circuit-breaker, Switch-Disconnector ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL01203004Z2015_11.pdf

Temperature dependency, Derating <http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172>

additional technical information for NZM power switch ftp://ftp.moeller.net/DOCUMENTATION/PDF/nzm_technic_de_en.pdf