# **HRN-43, HRN-43N** | Relay for complete monitoring 3-phase mains



Technical parameters	HRN-43	HRN-43N
Supply		
Supply terminals:	A1 - A2	
Supply voltage:	AC 110 V, AC 230 V, AC 400 V, AC/DC 24 V /	
	(AC 50 - 60 Hz)	
Consumption max.:	2.5 W / 5 VA (AC 110 V, AC 230 V, AC 400 V),	
	1.4 W / 2 VA (AC/DC 24 V)	
Supply voltage tolerance:	-15 %; +10 %	
Measuring circuit		
Voltage set:	3x 400 V / 50 Hz	3x 400 V / 230 V / 50 Hz
Monitored terminals:	L1, L2, L3	L1, L2, L3, N
Upper voltage level:	240 - 480 V	138 - 276 V
Bottom voltage level:	35 - 99 % Umax	
Max. permanent overload:	3x 480 V	
Hysteresis:	adjustable 5 % or 10 % of set value	
Asymmetry:	5 - 2	20 %
Peak overload < 1 ms:	600 V < 1 ms	350 V < 1 ms
Time delay t1:	fixed, max. 200 ms	
Time delay t2:	adjustable 0.1-10 s	
Accuracy		
Set. accuracy (mechanical):	5 %	
Repeat accuracy:	< 1 %	
Temperature dependance:	< 0.1 % / °C (°F)	
Limit values tolerance:	5 %	
Output		
Number of contacts:	2x changeover / SPDT (AgNi / Silver Alloy)	
Rated current:	16 A / AC1	
Switching capacity:	4000 VA / AC1, 384 W / DC	
Inrush current:	30 A / < 3 s	
Switching voltage:	250 V AC1 / 24 V DC	
Mechanical life:	3x10 <sup>7</sup>	
Electrical life (AC1):	0.7x10⁵	
Other information		
Operating temperature:	-20 °C to 55 °C (-4 °F to 131 °F)	
Storage temperature:	-30 °C to 70 °C (-22 °F to 158 °F)	
Electrical strength:	4 kV (supply - output)	
Operating position:	any	
Mounting:	DIN rail EN 60715	
Protection degree:	IP40 from front panel / IP20 terminals	
Overvoltage category:	III.	
Pollution degree:	2	
Max. cable size (mm²):	solid wire max. 1x 2.5 or 2x 1.5 /	
	with sleeve max. 1x 1.5 (AWG 12)	
Dimensions:	90 x 52 x 65 mm (3.5 x 2 x 2.6")	
Difficisions.	246 g (110V, 230 V, 400 V) (8.7 oz.), 146 g (24 V) (5.1 oz.	
Weight:		

- monitoring of 3-phase mains:
- voltage in 2 levels (undervoltage and overvoltage) in range 138-276 V (3x 400 V / 230 V) or 280-480 V (3x 400 V)
- phase asymmetry (can be switched off)
- phase sequence
- phase failure
- · adjustable function "MEMORY"
- function of second relay (independent / parallel)
- adjustable delay for short peaks for each level independently
- HRN-43: for circuits 3x 400 V (without neutral)
- HRN-43N: for circuits 3x 400 / 230 V (with neutral)
- galvanically separated supply voltage AC 400 V, AC 110 V, AC 230 V, AC/ DC 24 V
- output contact: 2x changeover 16 A / 250 V AC1
- 3-MODULE, DIN rail mounting


#### Description *>>>* DIP switch Supply indication - Umax Indication overvoltage Time delay t2 undervoltage, failure RESET button Phase asymmetry indication

16 | 15 | 18 | 28 | 25 | 26

00000


- Umin

### Description and importance of DIP switches




#### Connection

Symbol

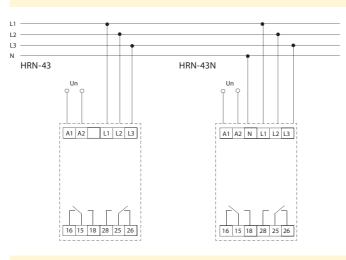


# HRN-43



# **HRN-43, HRN-43N** | Relay for complete monitoring 3-phase mains

#### **Function**

Overvoltage - undervoltage

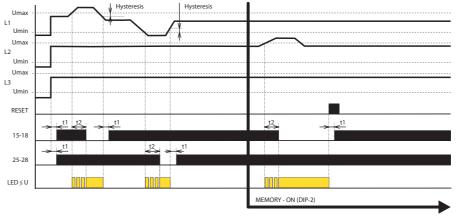

<u>Legend:</u> L1, L2, L3 - 3-phase voltage

RESET - press of the button on frontal panel t1 - time delay, fixed

t2 - time delay, adjustable

15-18 output relay 1


25-28 output relay 2 LED ≥ U - indication overvoltage / undervoltage

# Selection of 2<sup>nd</sup> the relay function:

In order to monitor 2 levels of voltage, it is possible to select if output relay will respond to each level individually (see the diagram) or both relays will switch in parallel way (see diagram "phase sequence").

75

Selection via DIP switch Output.

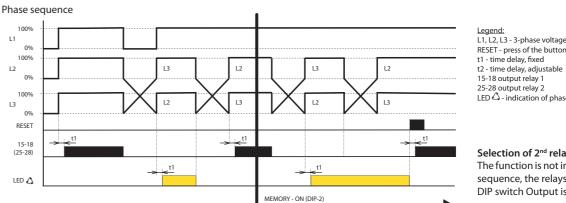

#### RESET - press of the button on frontal panel t1 - time delay, fixed


t2 - time delay, adjustable

15-18 output relay 1

25-28 output relay 2 LED △ - indication of phase sequence

#### Selection of 2<sup>nd</sup> relay function:

The function is not implied in the monitoring phase sequence, the relays are switched in parallel way. DIP switch Output is ignored.

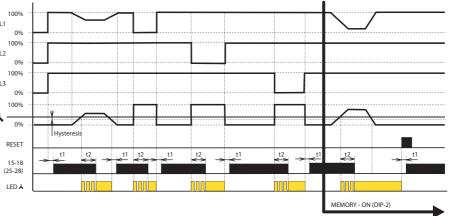

## L1, L2, L3 - 3-phase voltage RESET - press of the button on frontal panel t1 - time pause, fixed t2 - time pause, adjustable

- adjustable asymmetry

15-18 output contact of relay 1

25-28 output contact of relay 2

LED A - asymmetry indicator

# Selection of 2<sup>nd</sup> relay function:

The function is not implied in the monitoring phase sequence, the relays are switched in parallel way. DIP switch Output is ignored.

Relay is designated to monitor 3-phase circuits. Type HRN-43N controls voltage towards neutral wire, type HRN-43 controls interphase voltage. Relay can monitor voltage in two levels (overvoltage / undervoltage), phase assymetry, sequence and failure. Each faulty state is indicated by individual LED. By DIP switch (Output) it is possible to define function of the other relay - independent function (1x for overvoltage, 1x for undervoltage) or in parallel. Time delays t1(fixed) when changing from faulty to normal state or when de-energized and t2 (adjustable) when changing from normal to faulty state. These delays prevent incorrect conduct and oscillation of output device during short voltage peaks in the main or during gradual voltage decline into normal.

Asymmetry - phase failure

Set upper level Umax in range 138 - 276 V (or 240 - 480 V for HRN-43) and lower level Umin in range 35-99 % Umax. In case any phase passes this range, after a delay which eliminated short voltage peaks, contact opens. Output contact again switches after returning back into monitored voltage range and exceeding fixed hysteresis (which is adjustable in two values by DIP switch). In case of failure of two or three phases, the relay is deactivated immediately regardless of the set delay t2.

## Phase sequence

Monitors correctness of phase sequence. In case of unwanted change output contact breaks. In case of energization of a device with incorrect phase sequence, contact stays opened.

#### Asymmetry

Rate of assymetry between individual phases is set in a range of 5-20 %. In case set asymmetry is exceeded, output relay breaks and LED indicating asymmetry shines. Delays t1, t2 and hysteretic are applicable when returning to normal state. Monitoring asymmetry can be switched off by DIP switch ASYM.